




**Note these points in the following wiring diagrams for Venkon AC with electromechanical control:**

- Comply with the details on cable types and cabling with due consideration for VDE 0100.
- Without \*: NYM-J. The requisite number of wires, including protective earth, is stated on the cable. Cross-sections are not stated, as the cable length is involved in the calculation of the cross-section.
- With \*: J-Y(ST)Y 0.8mm. Lay separately from power lines.
- If other types of cables are used, they must be at least equivalent.
- The terminals on the unit are suitable for a maximum wire cross-section of 2.5 mm<sup>2</sup>.
- The electrical data need to be respected when rating the in situ mains power supply and fusing.

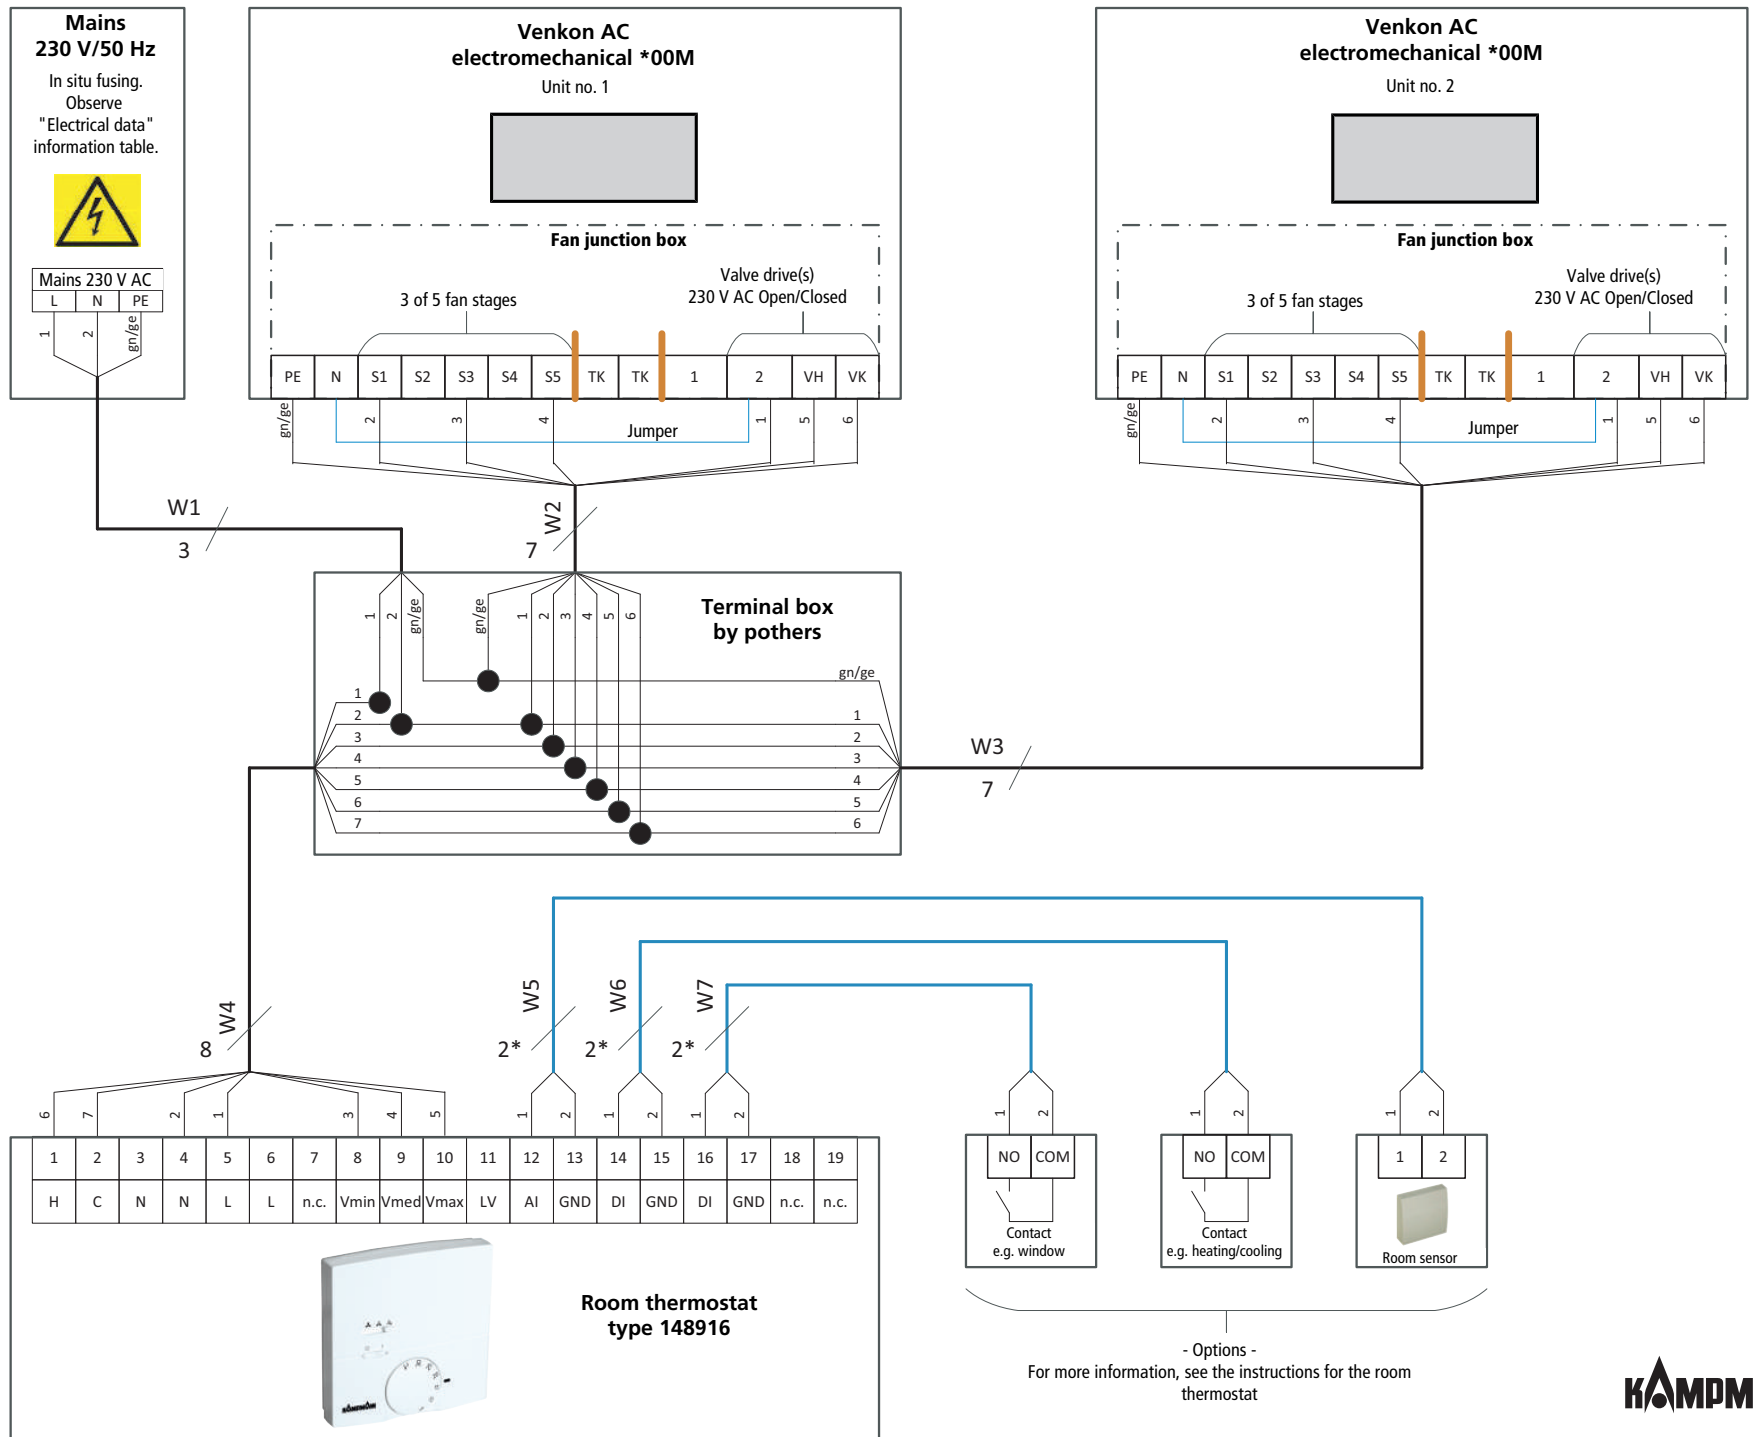

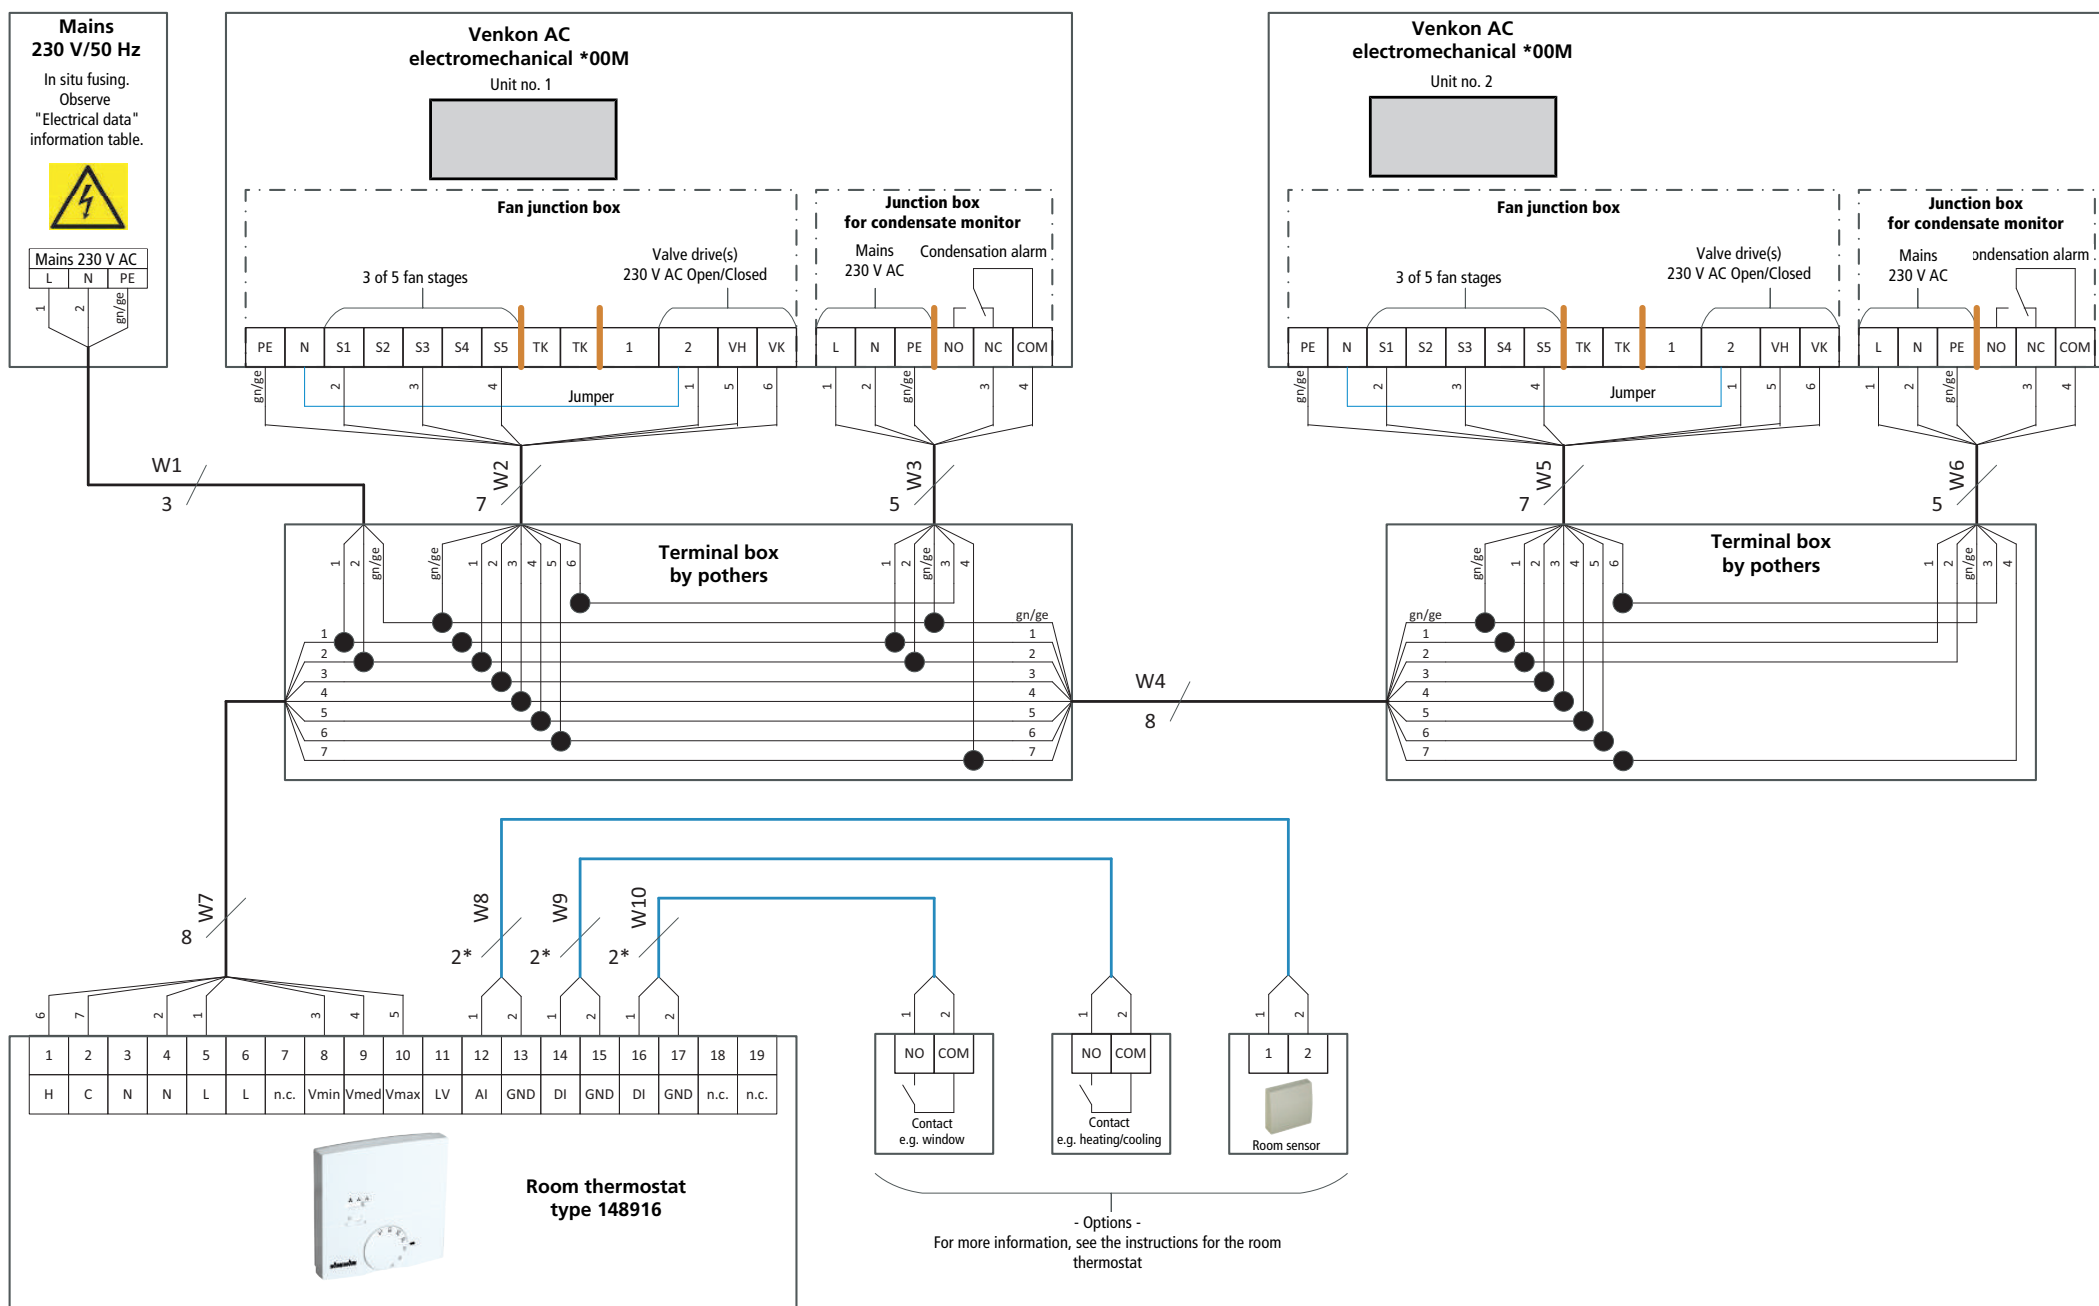


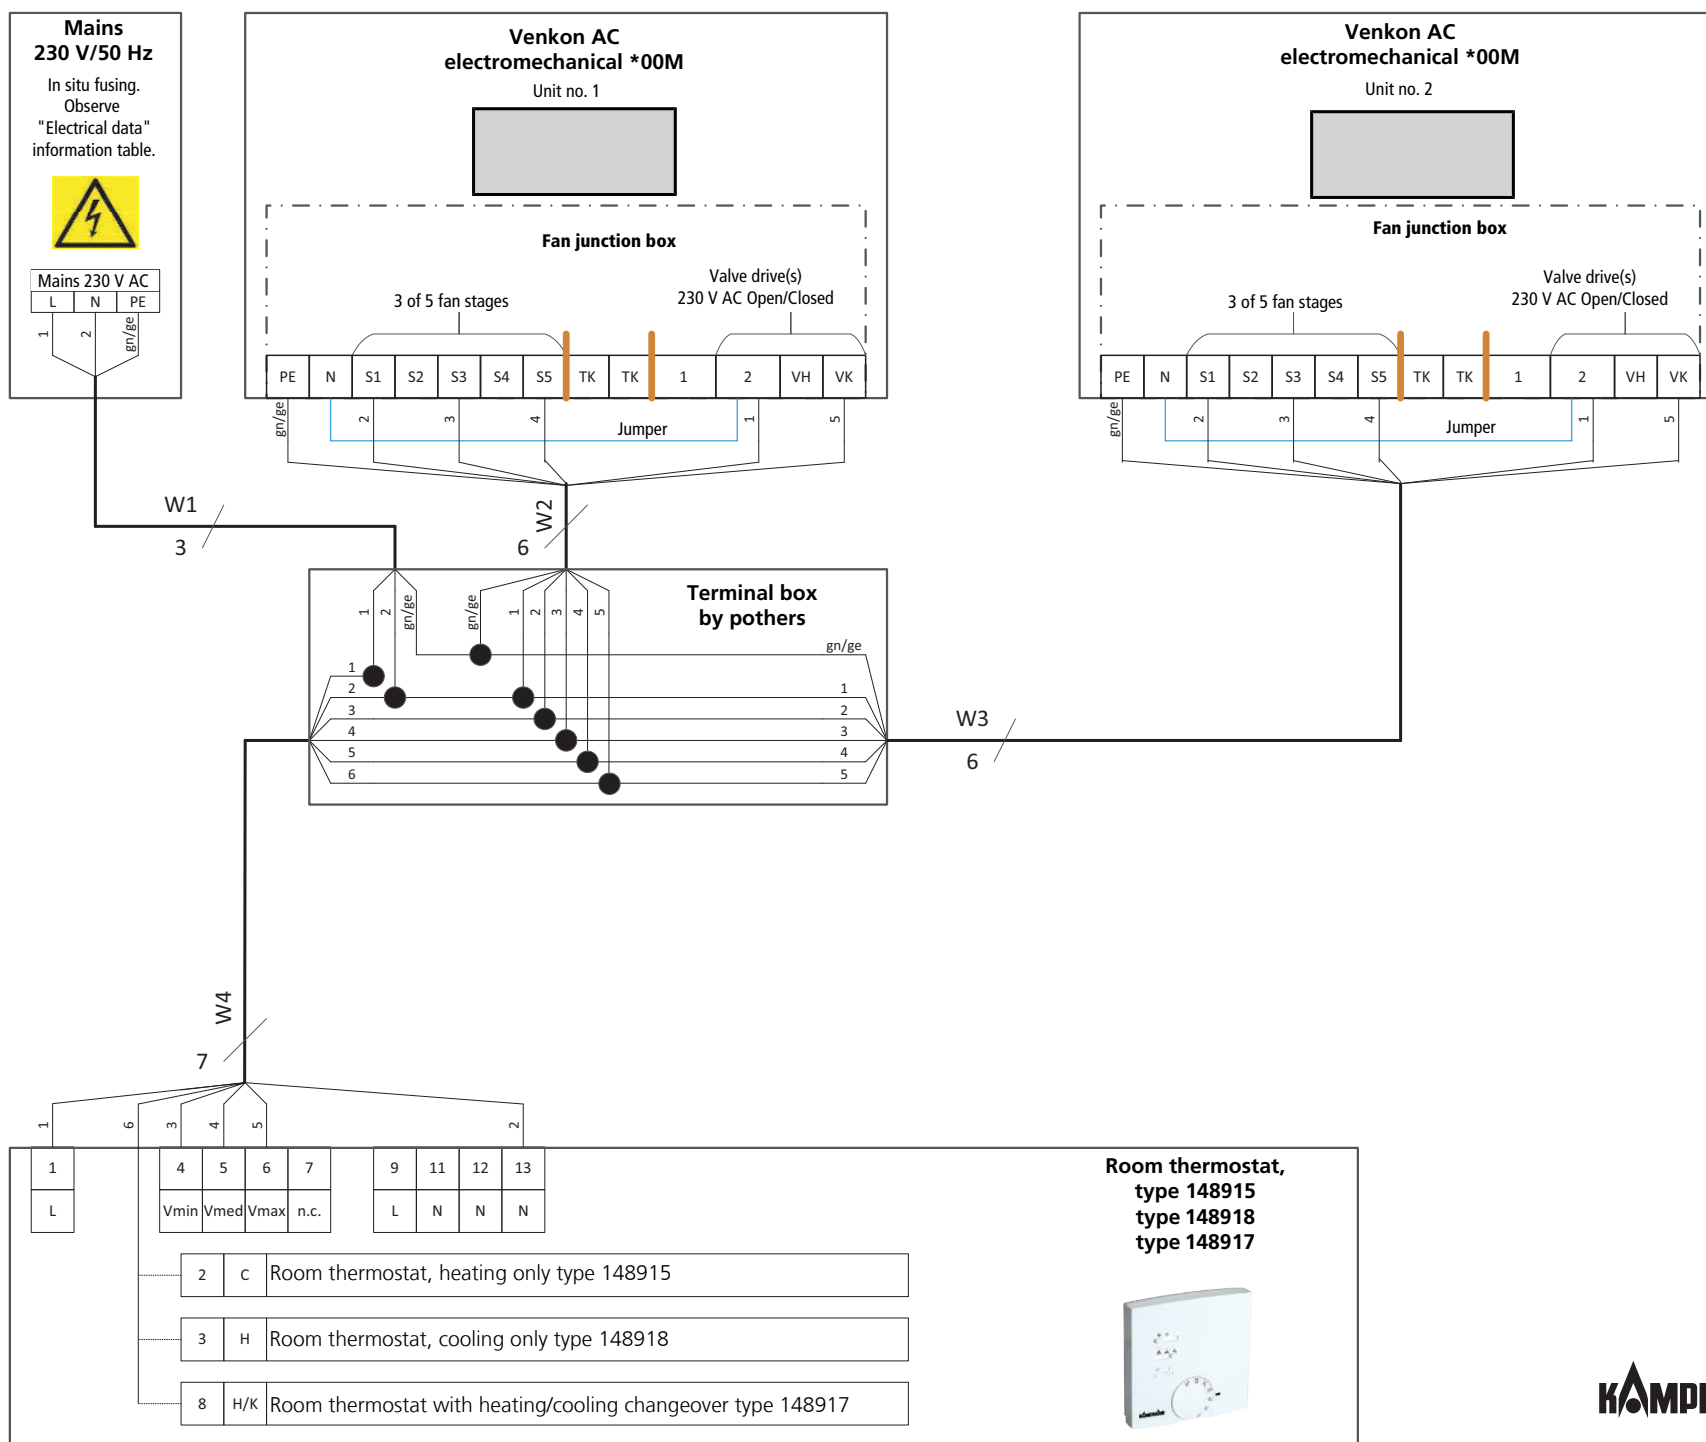





**Note these points in the following wiring diagrams for Venkon EC with electromechanical control:**


- ▶ Comply with the details on cable types and cabling with due consideration for VDE 0100.
- ▶ Without \*: NYM-J. The requisite number of wires, including protective earth, is stated on the cable. Cross-sections are not stated, as the cable length is involved in the calculation of the cross-section.
- ▶ With \*: J-Y(ST)Y 0.8mm. Lay separately from power lines.
- ▶ If other types of cables are used, they must be at least equivalent.
- ▶ The terminals on the unit are suitable for a maximum wire cross-section of 2.5 mm<sup>2</sup>.
- ▶ Only pulse and/or all-current sensitive residual current protective devices (type A or B) are permitted when using residual current protective devices. When power is applied to the unit, pulse-like capacitor load currents in the integrated EMC filter can lead to the RCCB being immediately tripped. We recommend residual current protective switches with a threshold of 300 mA and delayed triggering (super resistant, characteristic K).
- ▶ The electrical data need to be respected when rating the in situ mains power supply and fusing.

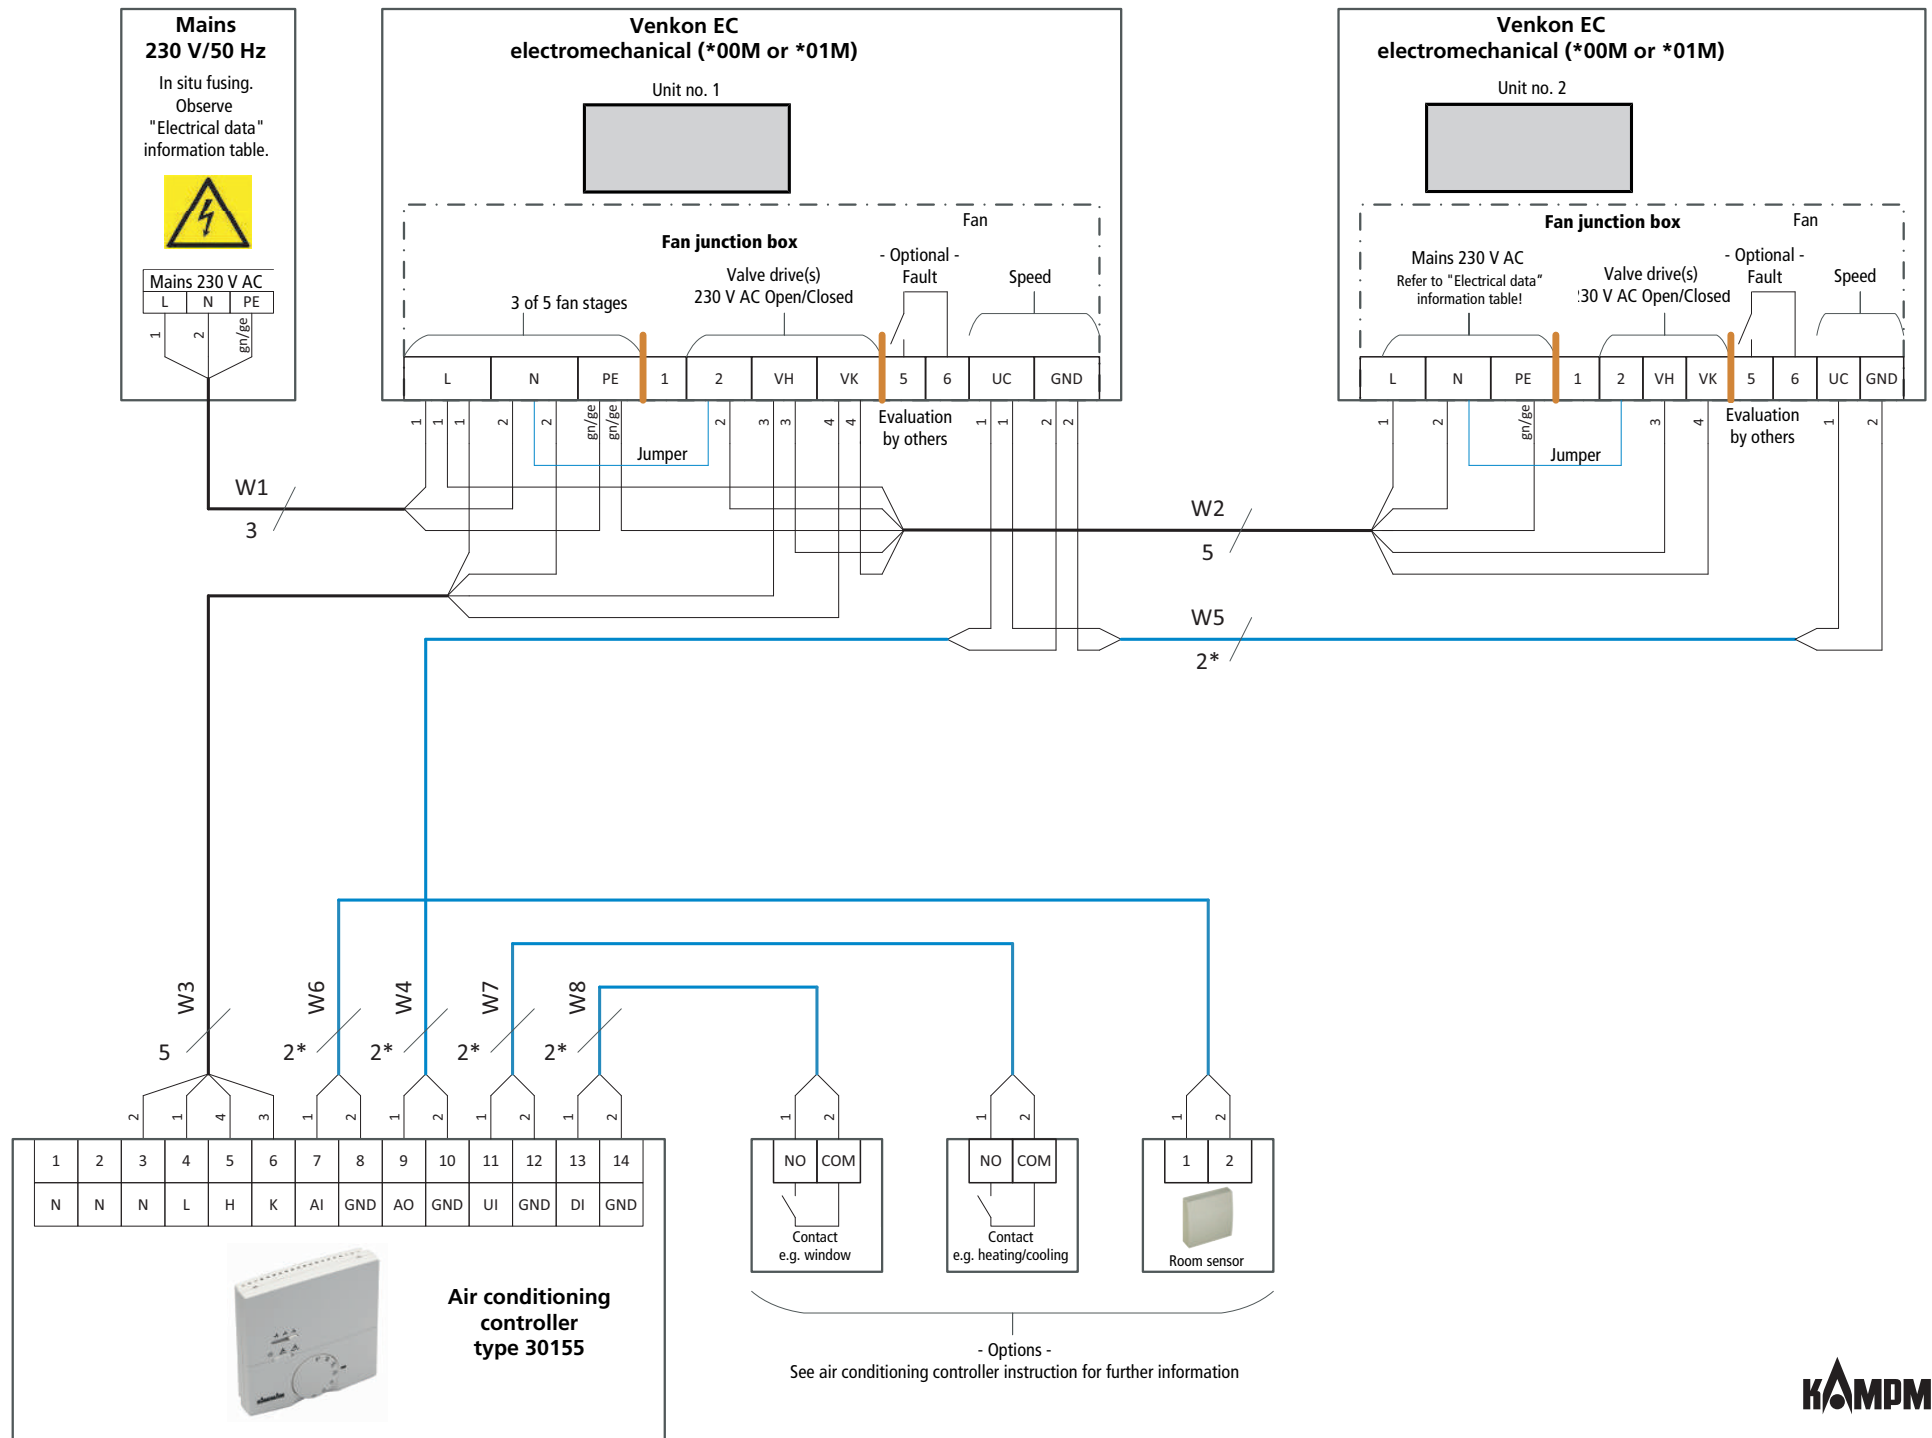


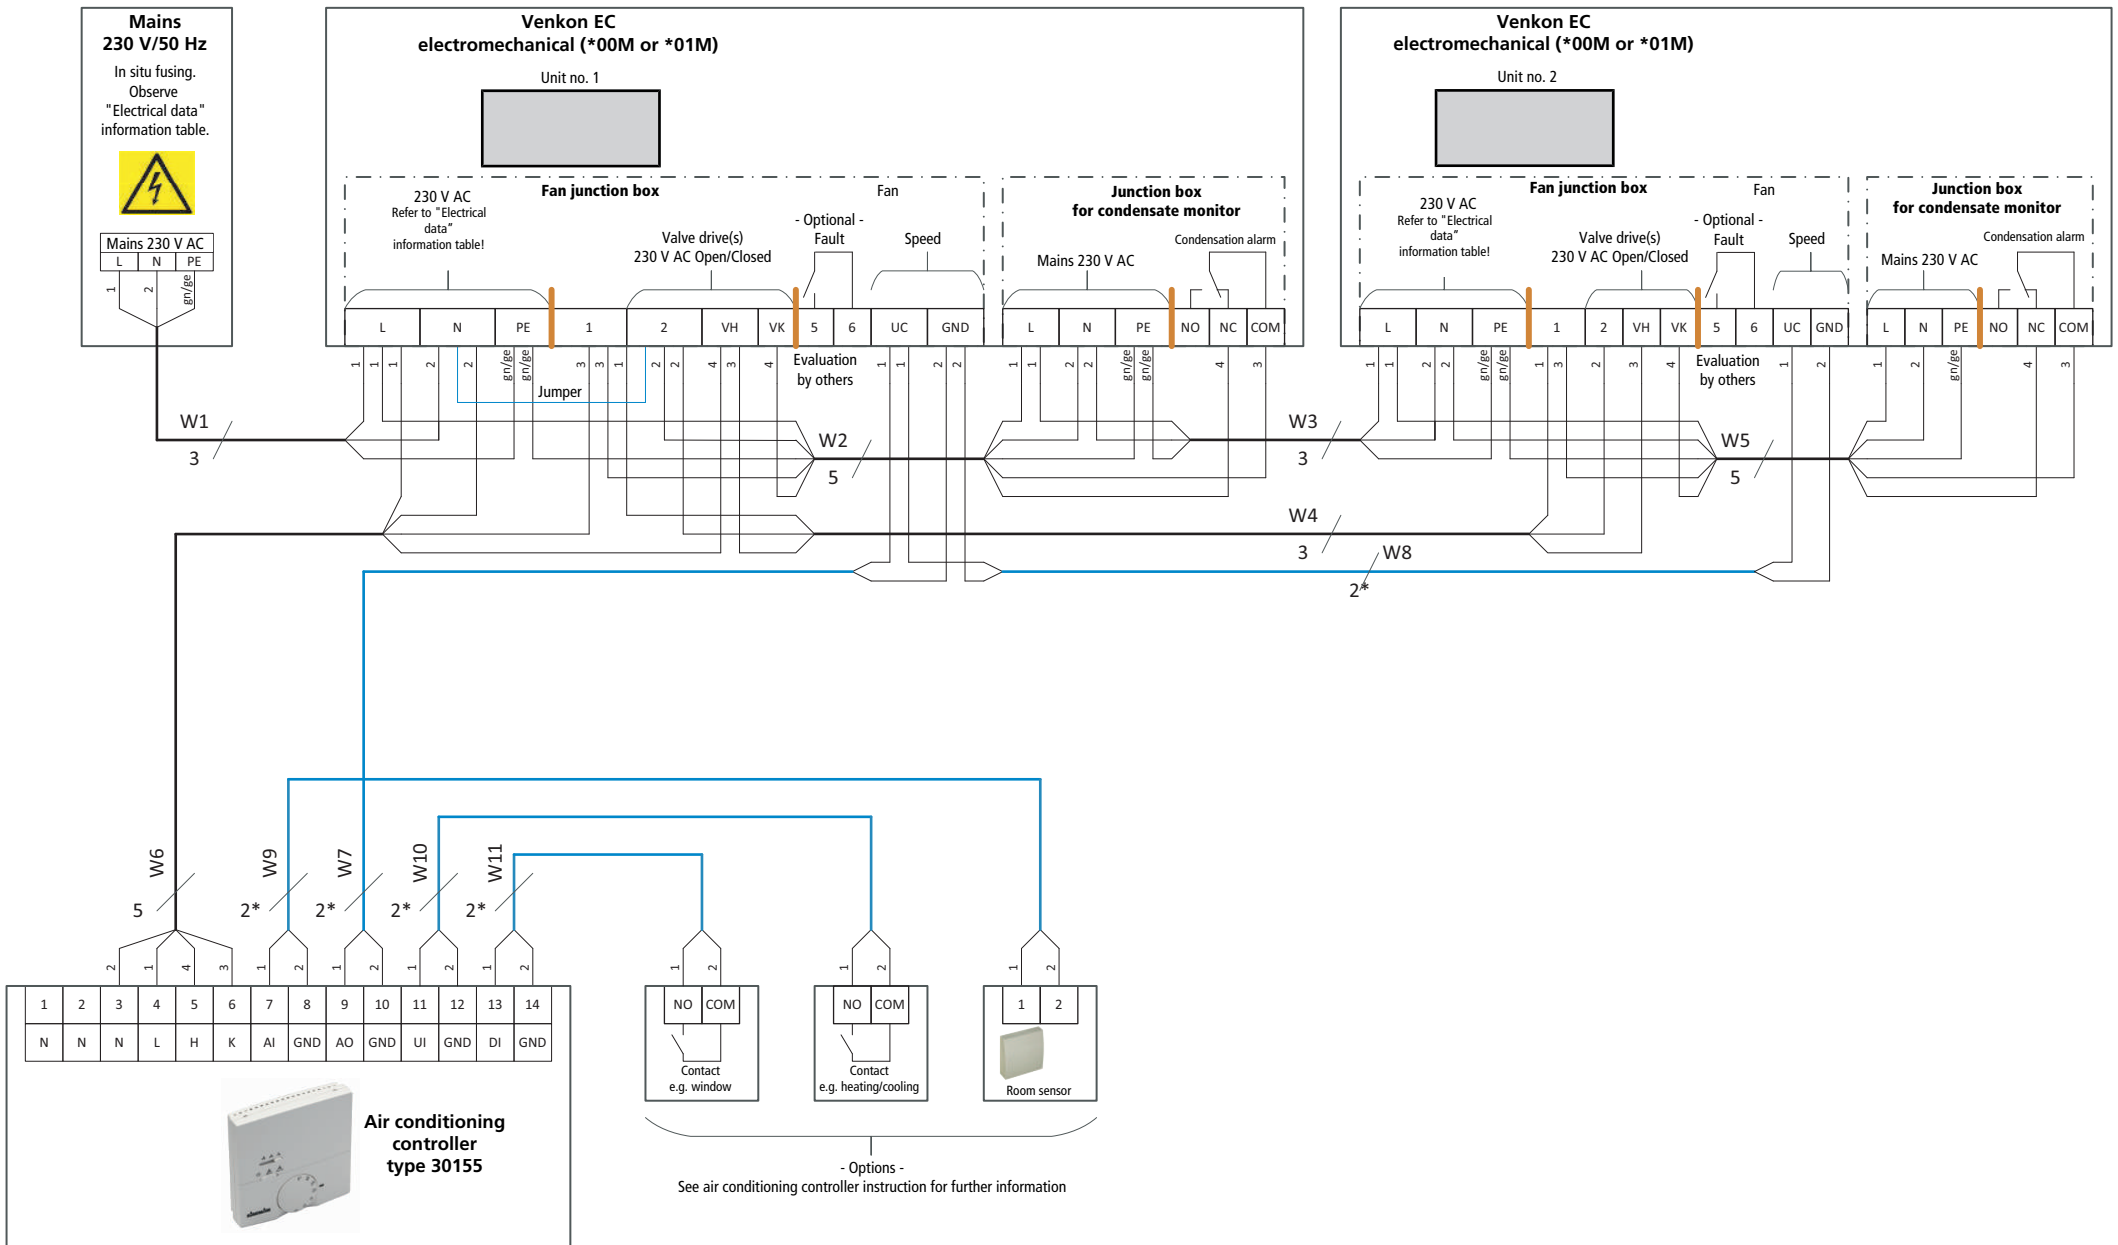



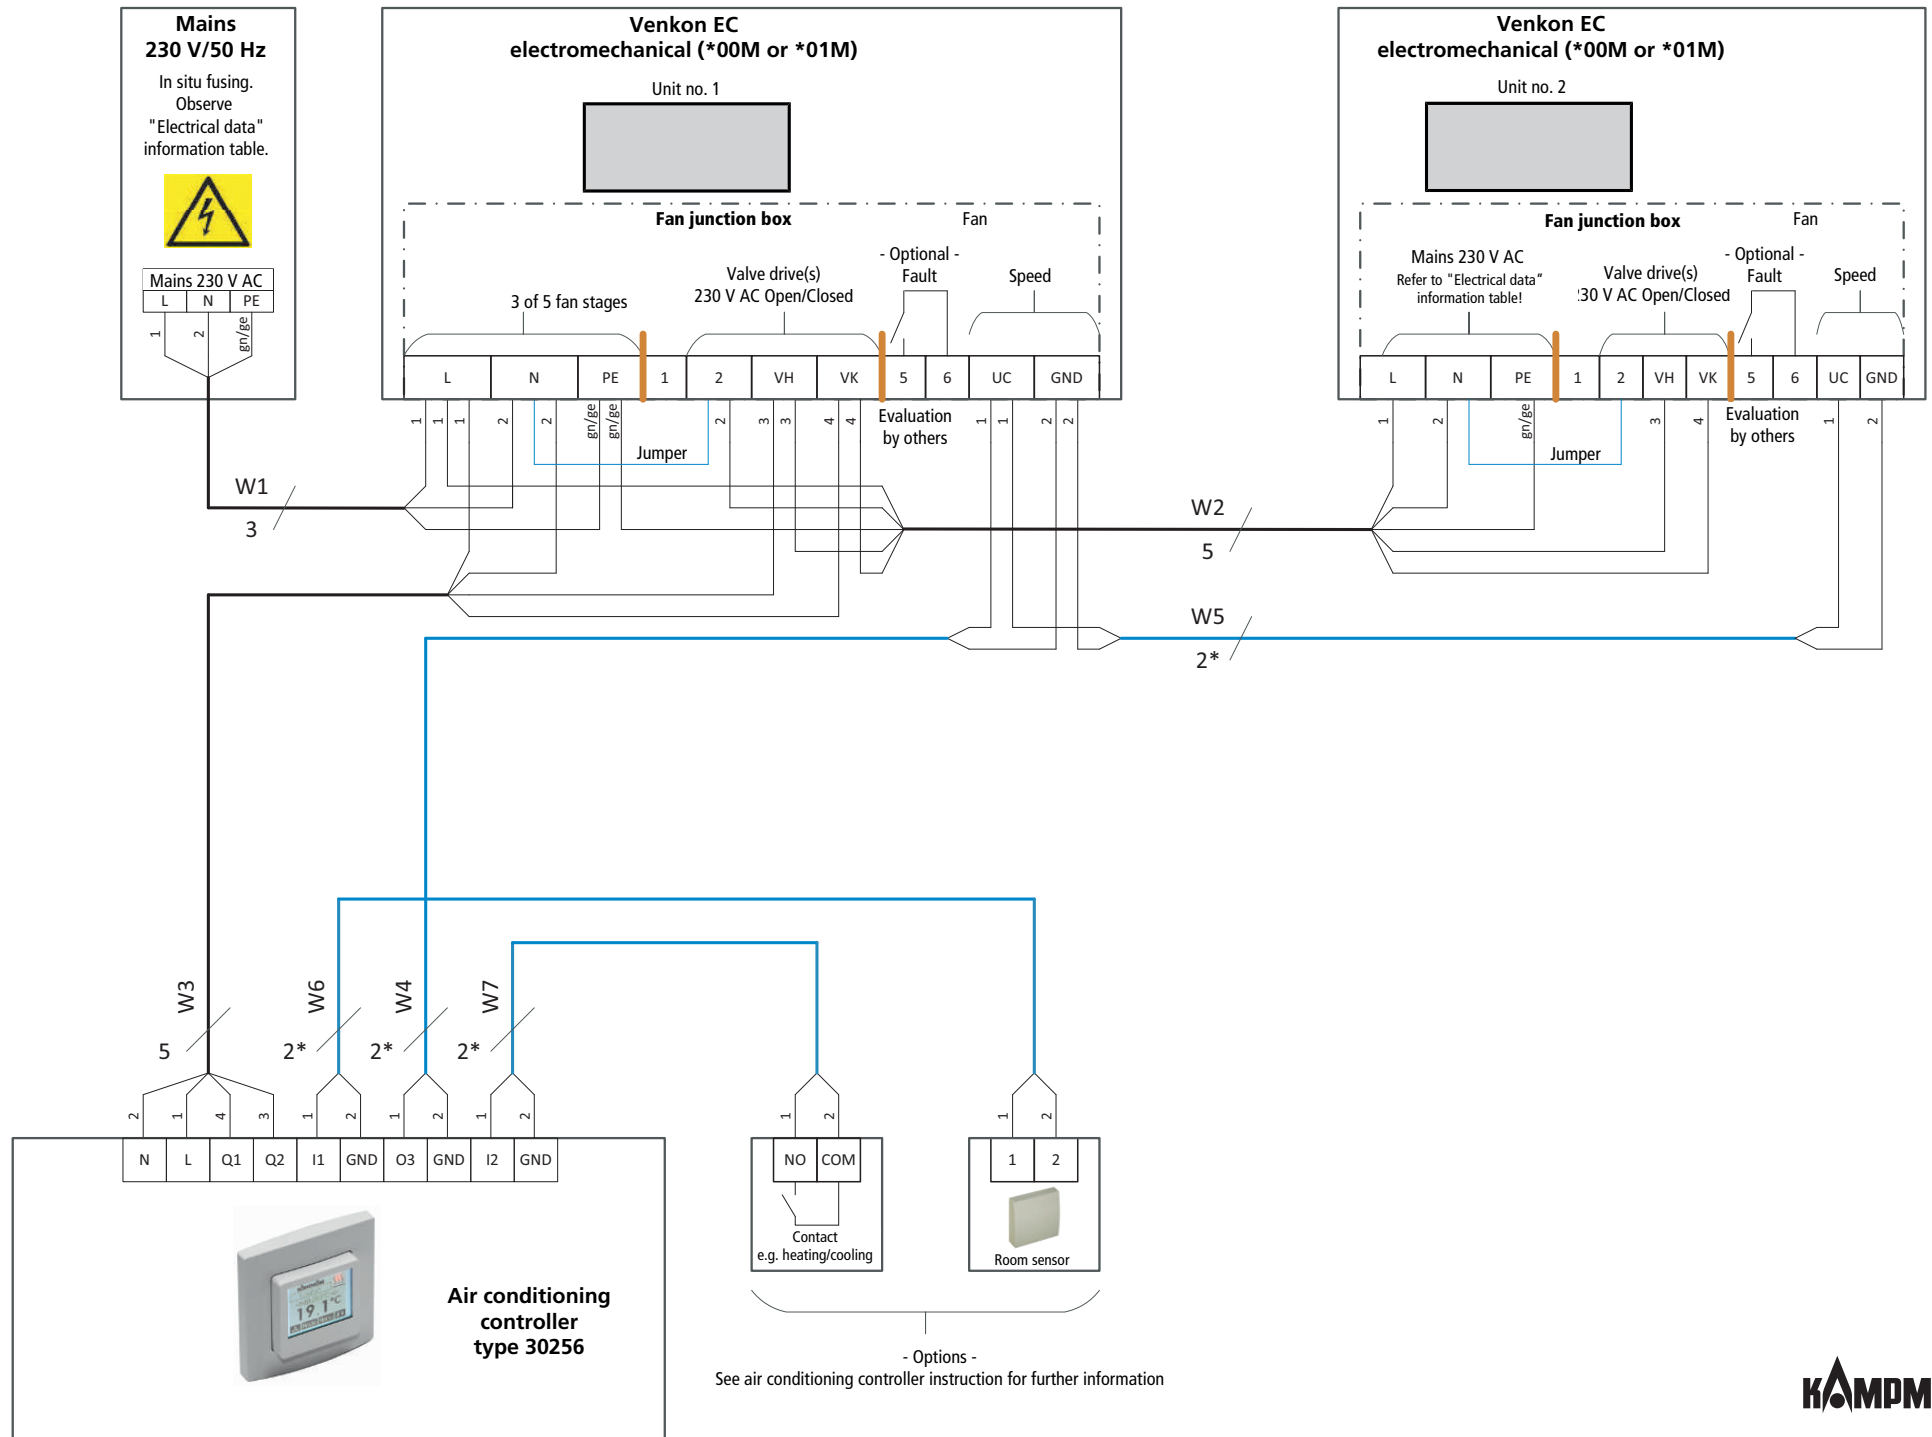

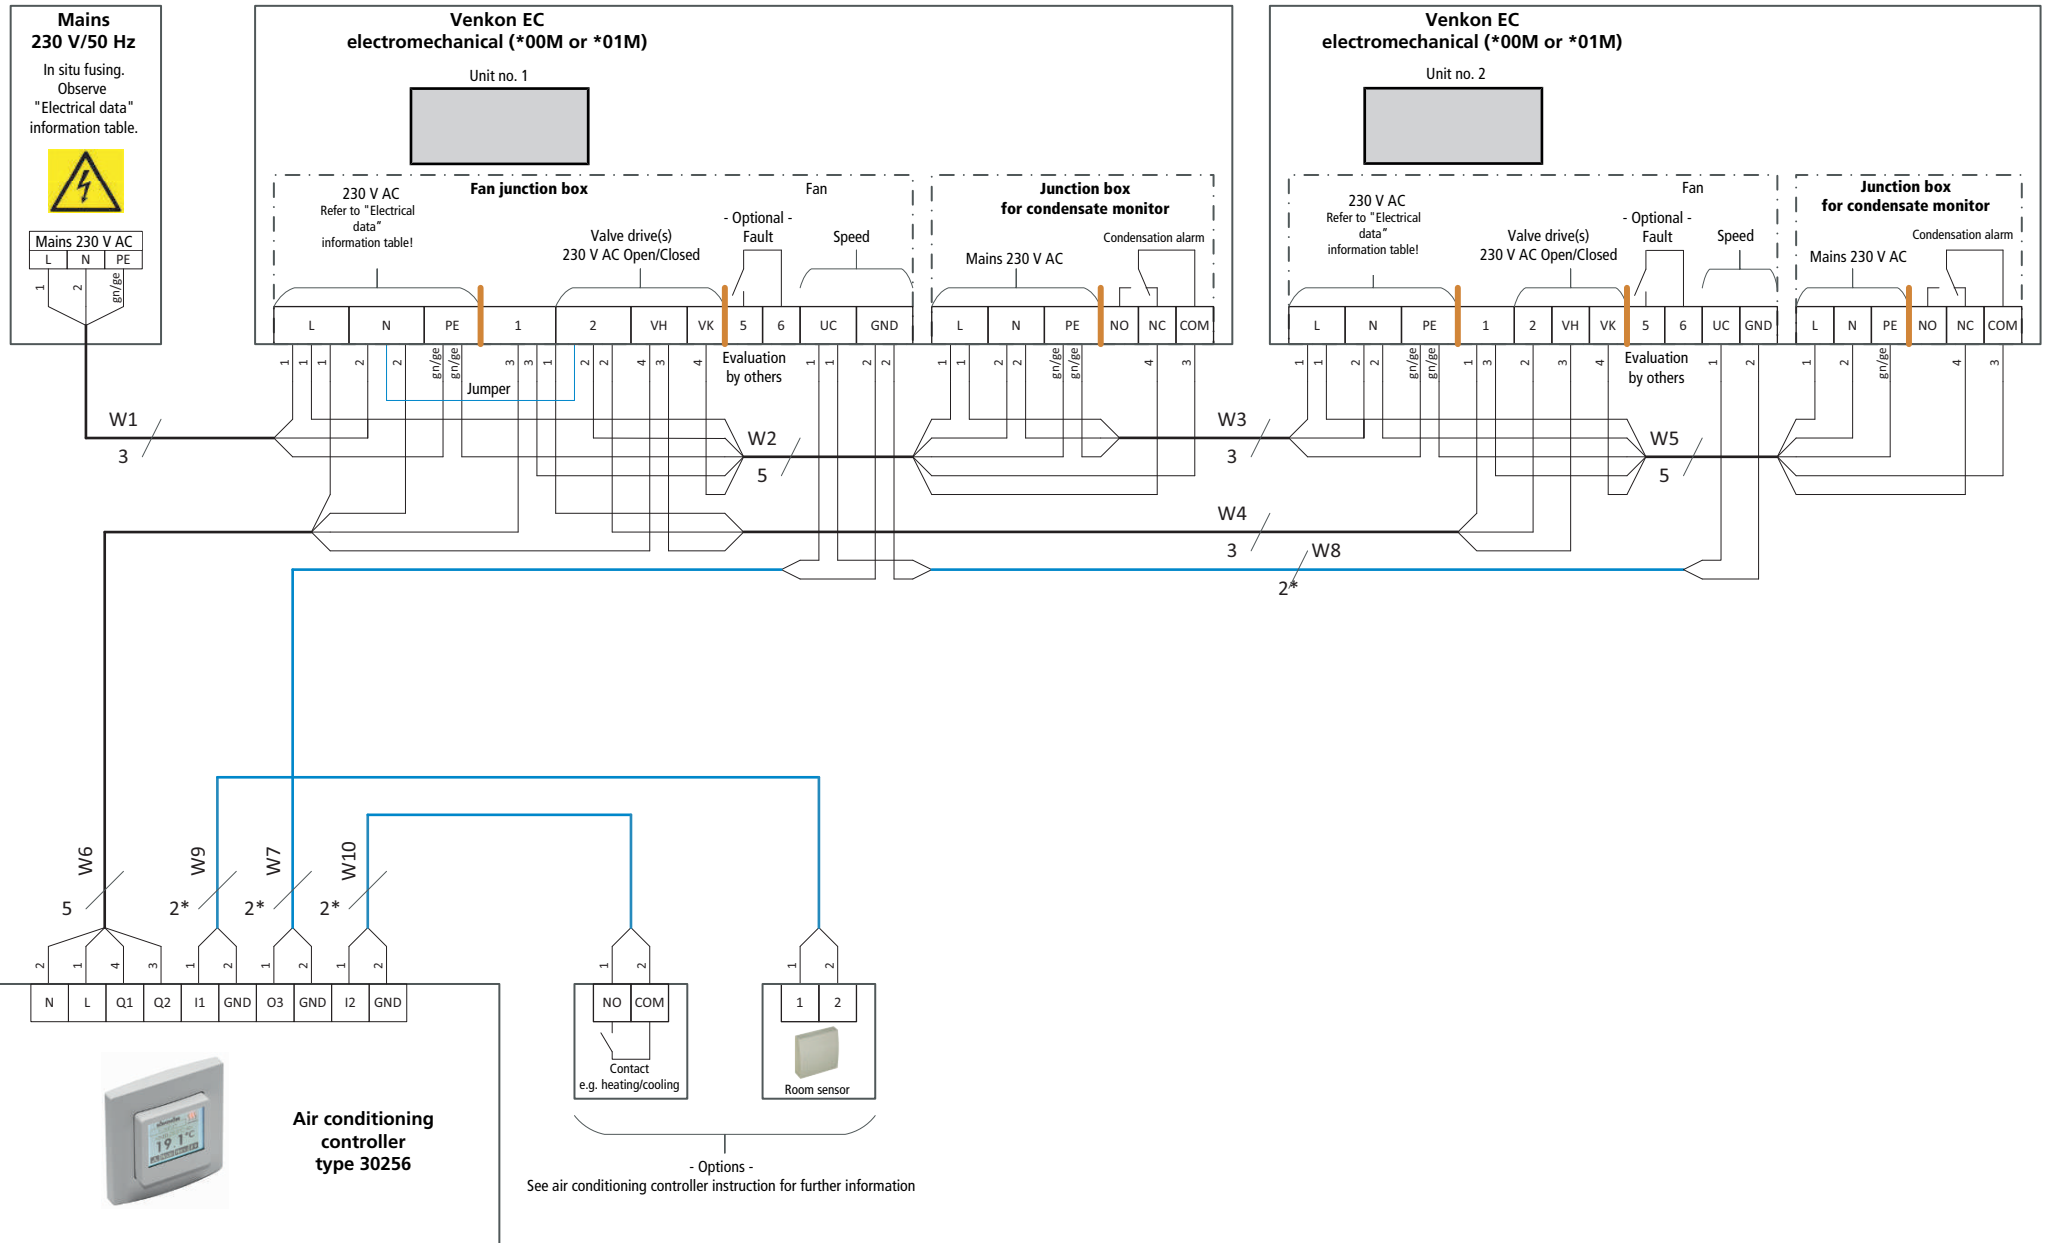

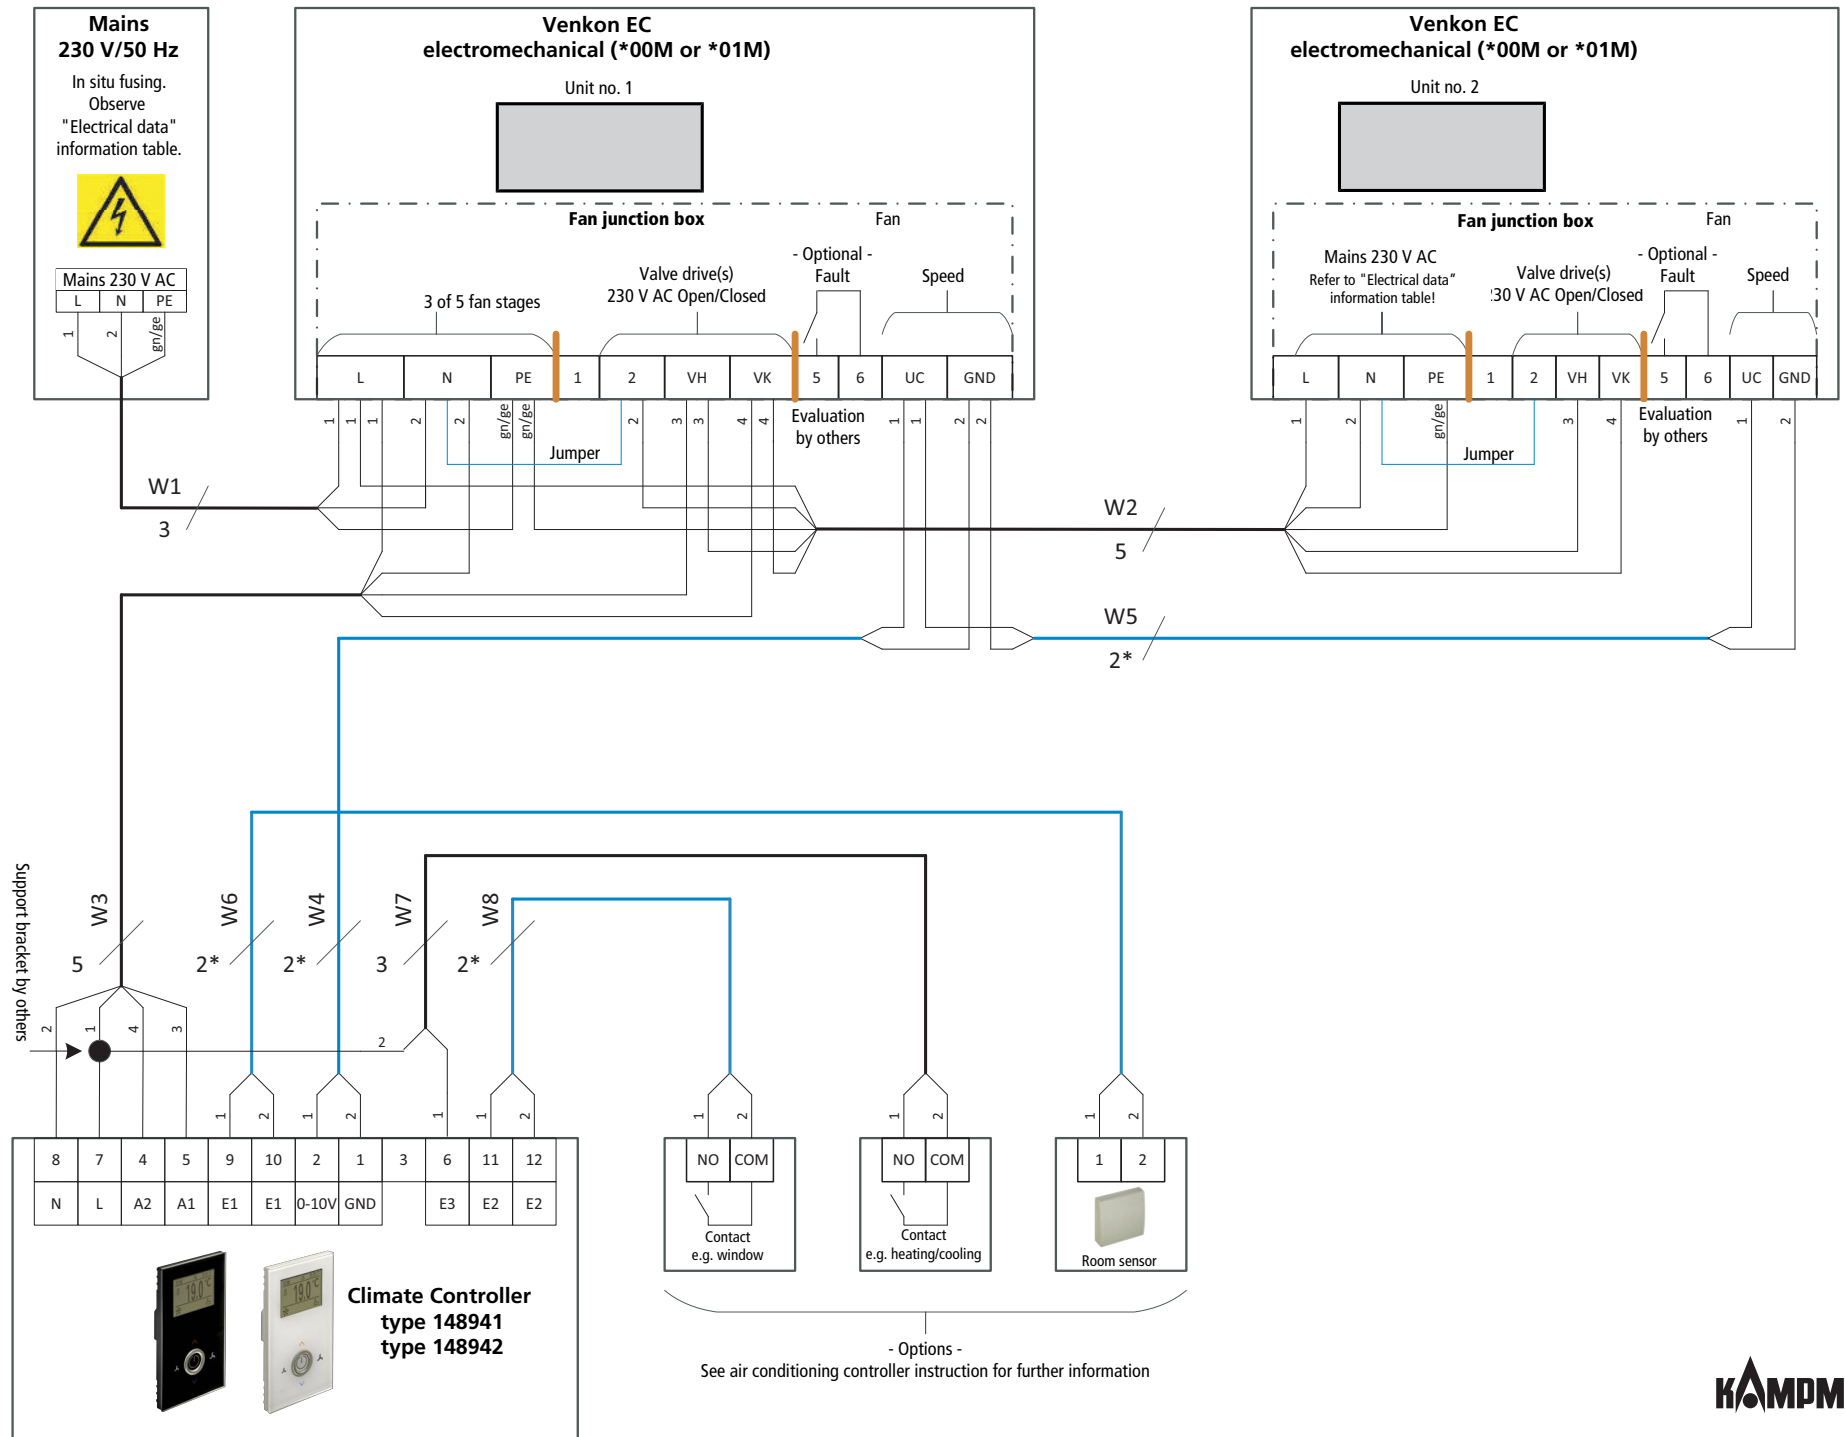

# Cabling, Venkon EC (\*00M or 01M), control by Climate Controller Type 148941/148942, with condensation monitor

Venkon

